


QT-Brightek Chip LED Series
1208 IR LED with Dome Lens

Part No.: QBLP653-IR3

Product: QBLP653-IR3	Date: May 11, 2015	Page 1 of 9
	Version# 1.0	



1208 LED with Lens



Table of Contents:	
Introduction	3
Electrical / Optical Characteristic (Ta=25 °C)	
Absolute Maximum Rating	⊿
Characteristic Curves	5
Solder Profile & Footprint	6
Packing	7
Labeling	8
Ordering Information	8
Revision History	ç
Disclaimer	ç

Product: QBLP653-IR3	Date: May 11, 2015	Page 2 of 9
	Version# 1.0	



Introduction

Feature:

- Water clear lens
- Tape and reel packaging
- Bright LED package
- AlGaAs technology for IR
- Viewing Angle = 15 deg

Description:

This reversed mount light weight bright 1208 LEDs have a height profile of 2.5mm. With narrow viewing angle, LED produces high intensity output. This device is spectrally matched with phototransistor, photodiode and infrared receiver module.

Application:


- Free air transmission system
- Optoelectronic switch
- Infrared applied system
- Smoke Detector

Certification & Compliance:

- TS16949
- ISO9001
- RoHS Compliant



Dimension:

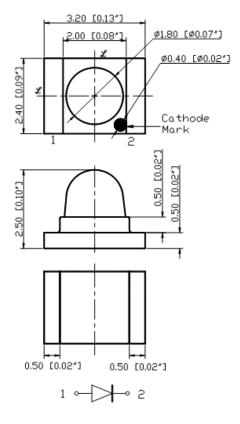

Units: mm / tolerance = +/-0.1mm

Product: QBLP653-IR3	Date: May 11, 2015	Page 3 of 9
	Version# 1.0	



Electrical / Optical Characteristic (Ta=25 °C)

Product Color	Color	I (m A)		V _F (V)			λ _P (nm)	le	(mW/s	r)
	I _F (mA)	Min.	Тур.	Max.	Min.	Тур.	Max.	Min.	Тур.	Max.	
QBLP653-IR3	Infrared	20	1.0	1.5	1.8	840	850	860	2.1	3.0	6.1

Absolute Maximum Rating


_								
	Material	P _d (mW)	I _F (mA)	I _{FP} (mA)*	V _R (V)	T _{OP} (°C)	T _{ST} (°C)	T _{SOL} (°C)**
	AlGaAs	90	50	1	5	-40 to +80	-40 to +85	260


Product: QBLP653-IR3	Date: May 11, 2015	Page 4 of 9
	Version# 1.0	

^{*}Pulse width 100µs, duty cycle=1%
**IR Reflow for no more than 10 sec @ 260 °C




Characteristic Curves

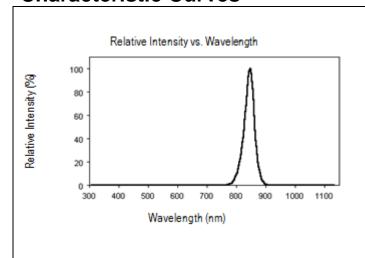

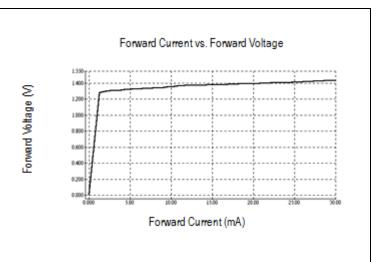

Directive Characteristics

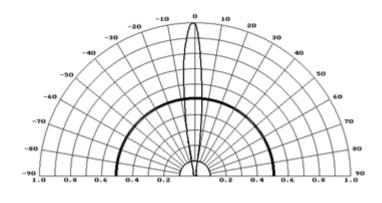



Product: QBLP653-IR3	Date: May 11, 2015	Page 5 of 9
	Version# 1.0	



Solder Profile & Footprint

- -Recommended tin solder specifications: melting temperature in the range of 178~192 $^{\rm O}{\rm C}$
- -The recommended reflow soldering profile is as follows (temperatures indicated are as measured on the surface of the LED resin):

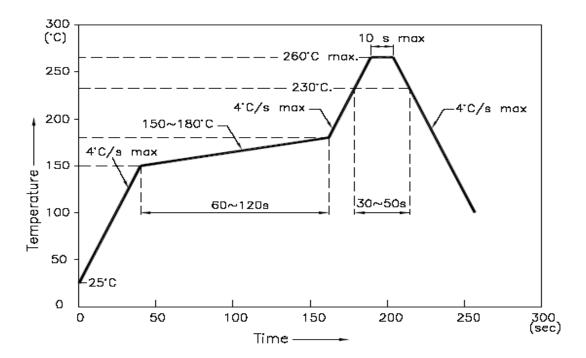

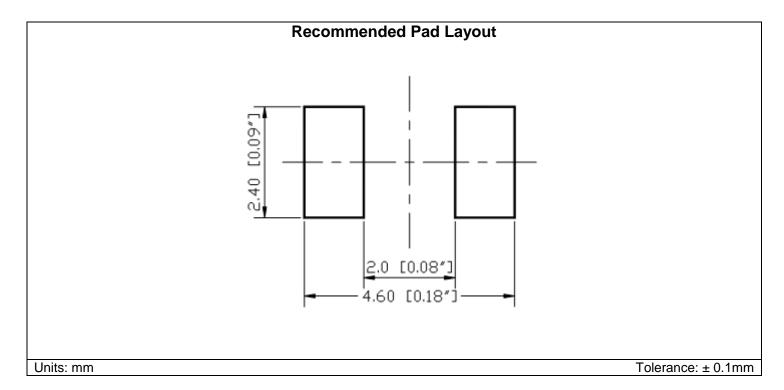


Product: QBLP653-IR3	Date: May 11, 2015	Page 6 of 9
	Version# 1.0	




Packing

Reel Dimensions:




Tape Dimensions:

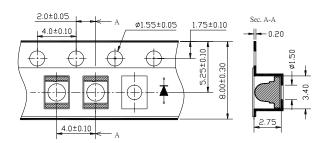


Unit: mm

Arrangement of Tape:

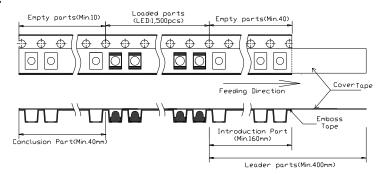

Packing specifications

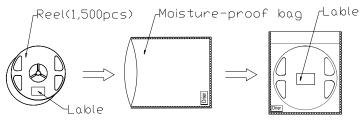

Product: QBLP653-IR3	Date: May 11, 2015	Page 7 of 9
	Version# 1.0	




Labeling

		QT-Brightek	€
Par	t No:		
Cus	stome	r P/N:	
<u>lten</u>	n:		
Q'ty	/ :		
∨ f:			
Iv:			
WI:			
Dat	te:		
		Made in China	

Ordering Information

Part #	Orderable Part #	Spec Range	Quantity per reel
QBLP653-IR3	QBLP653-IR3	Ie=3.0mW/sr @ 20mA, λ _P =850nm typ.	1,500 pcs

Product: QBLP653-IR3	Date: May 11, 2015	Page 8 of 9
	Version# 1.0	



1208 LED with Lens



Revision History

Description:	Revision #	Revision Date
New Release of QBLP653-IR3	V1.0	05/11/2015

Disclaimer

QT-BRIGHTEK reserves the right to make changes without further notice to any products herein to improve reliability, function or design. QT-BRIGHTEK does not assume any liability arising out of the application or use of any product or circuit described herein; neither does it convey any license under its patent rights, nor the rights of others.

Life Support Policy

QT-BRIGHTEK's products are not authorized for use as critical components in life support devices or systems without the express written approval of QT-BRIGHTEK. As used herein:

- 1. Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
- 2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.

Product: QBLP653-IR3	Date: May 11, 2015	Page 9 of 9
	Version# 1.0	